


VMH-V Series

Combinations Chart

SINGLE/MULTI ZONE MINI-SPLITS

6,000 to 55,000 BTUH

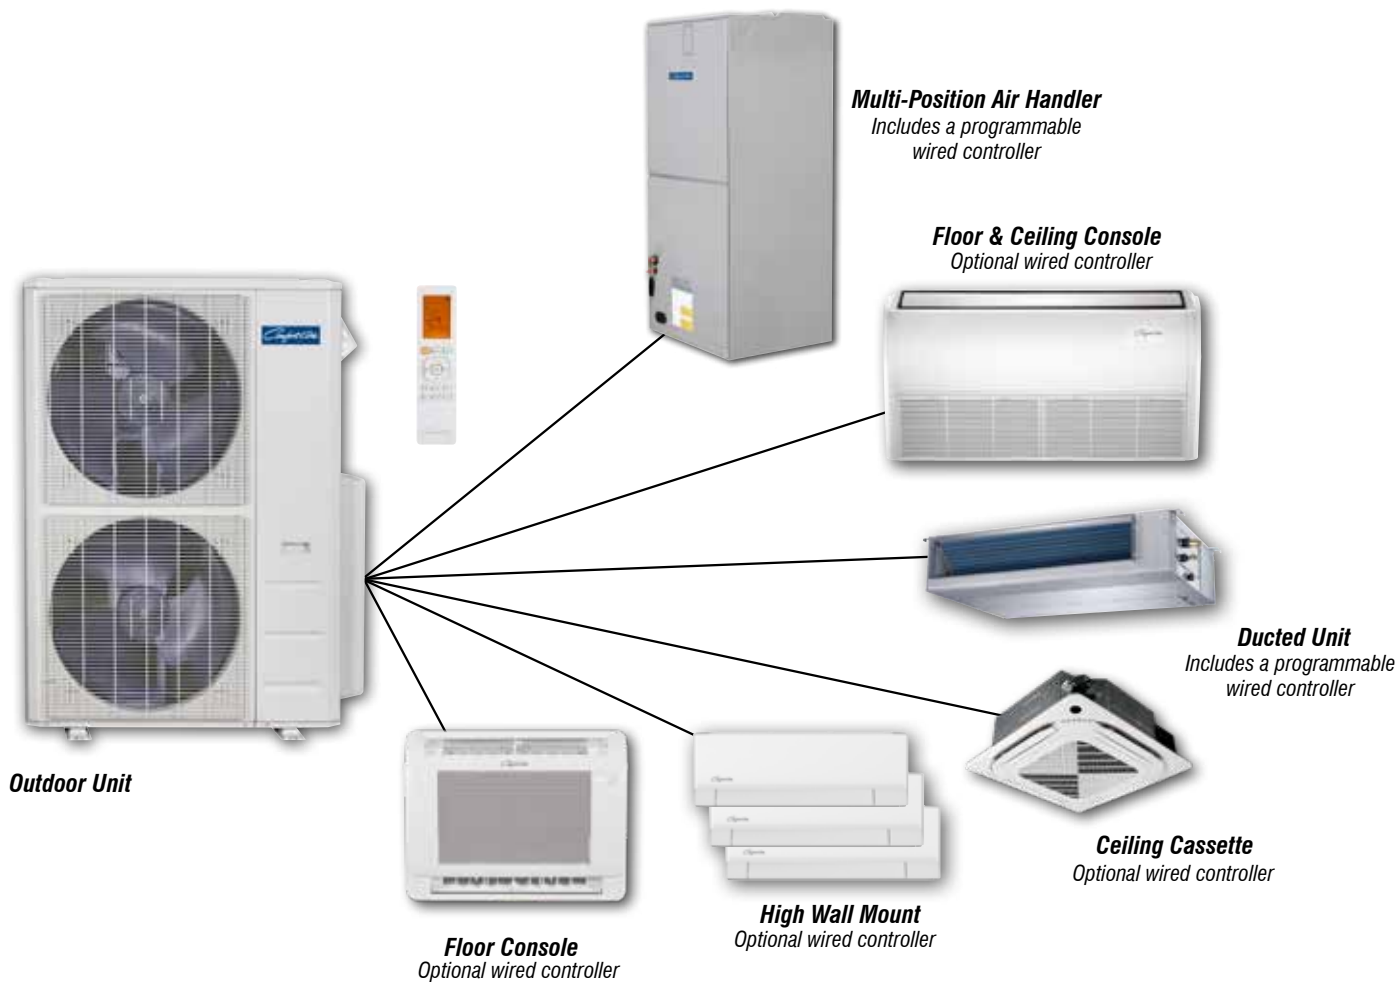

Comfort-Aire®

Warranty—10 years on compressor, 10 years on parts
(Some limitations apply; see printed warranty for details.)

www.comfort-aire.com

MINI-SPLIT COMBINATIONS (INCLUDING AIR HANDLERS)

Due to the extensive potential combinations, not all possible matches can be shown. For those combinations not on this table, confirm that total capacity of all connected heads is **NOT** below 66% or above 133% of nominal outdoor unit capacity.

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH28TV-1 Hyper 1 drive 3	Wall mounted: 6K/ 9K/12K/18K Cassette: 6K/9K/12K/18K Duct/Console: 9K/12K/18K AHU: 18K	Wall mounted: 9+9+9 Duct: 9+9+9	6+18	24
			9+18	27
			12+18	30
			6+6+18	30
			6+9+18	33
			6+12+18	36
			9+9+18	36
			9+12+18	39
			A-VMH36QV-1/ A-VMH36QV-1A Hyper 1 drive 4	Wall mounted: 6K/9K/12K/ 18K/24K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18/24K Console: 12K/18K AHU: 18K/24K
6+24	30			
9+18	27			
9+24	33			
12+18	30			
12+24	36			
18+18	36			
18+24	42			
24+24	48			
6+6+24	36			
6+9+18	33			
6+9+24	39			
6+12+18	36			
6+12+24	42			
9+9+18	36			
9+9+24	42			
9+12+18	39			
9+12+24	45			
12+12+18	42			
12+12+24	48			
6+6+6+18	36			
6+6+6+24	42			
6+6+9+18	39			
6+6+9+24	45			
6+6+12+18	42			
6+6+12+24	48			
6+9+9+18	45			
6+9+9+24	51			
6+9+12+18	48			
6+9+12+24	51			
6+12+12+18	48			
6+12+12+24	54			
9+9+9+18	45			
9+9+9+24	51			
9+9+12+12	42			
9+9+12+18	48			
9+9+12+24	54			
9+12+12+18	51			
12+12+12+18	54			

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH48PV-1 1 drive 5	Wall mounted: 6K/9K/12K/ 18K/24K/ 30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18/24K Console: 12K/18K AHU: 18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+18	24
			6+24	30
			6+30	36
			6+36	42
			9+18	24
			9+24	33
			9+30	39
			9+36	45
			12+18	30
			12+24	36
			12+30	42
			12+36	48
			18+18	36
			18+24	42
			18+30	48
			18+36	54
			24+24	48
			24+30	54
			24+36	60
			6+6+24	36
			6+9+18	33
			6+9+24	39
			6+12+18	36
			6+12+24	42
			9+9+18	36
			9+9+24	42
			9+12+18	36
			9+12+24	42
			9+12+18	39
			9+12+24	45
			12+12+18	42
			12+12+24	48
			6+6+30	42
			6+12+30	48
			9+9+30	48
			9+12+30	52
			12+12+30	54
			6+6+36	48
			6+12+36	54
			9+9+36	54
			9+12+36	58
			6+6+6+18	36
6+6+6+24	42			
6+6+9+18	39			
6+6+9+24	45			
6+6+12+18	42			
6+6+12+24	48			
6+9+9+18	42			
6+9+9+24	48			

NOTE: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.

MINI-SPLIT COMBINATIONS (INCLUDING AIR HANDLERS)

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH48PV-1 1 drive 5	Wall mounted: 6K/9K/12K/ 18K/24K/ 30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18/24K Console: 12K/18K AHU: 18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+9+12+18	45
			6+9+12+24	51
			6+12+12+18	48
			6+12+12+24	54
			9+9+9+18	45
			9+9+9+24	51
			9+9+12+18	54
			9+9+12+24	54
			9+12+12+18	51
			9+12+12+24	56
			12+12+12+18	54
			12+12+12+24	60
			6+6+6+30	48
			6+6+9+30	51
			6+6+12+30	54
			6+9+9+30	54
			9+9+9+30	57
			9+9+9+30	57
			9+9+12+30	60
			9+12+12+30	60
			6+6+6+6+18	42
			6+6+6+6+24	48
			6+6+6+12+18	48
			6+6+6+12+24	54
			6+9+9+9+18	51
			6+9+9+9+24	57
			6+9+9+12+18	54
			6+9+9+12+24	60
			6+9+12+12+18	57
			6+9+12+12+24	63
6+12+12+12+18	60			
9+9+9+9+18	36			
9+9+9+9+24	60			
9+9+9+12+24	63			
9+9+9+12+18	57			
9+9+12+12+18	60			
9+12+12+12+18	64			
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/9K/12K/ 18K/24K/ 30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18/24K Console: 12K/18K AHU: 18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+18	24
			6+24	30
			9+18	27
			9+24	33
			12+18	30
			12+24	36
			18+18	36
			18+24	42
24+24	48			

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/9K/12K/ 18K/24K/ 30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18/24K Console: 12K/18K AHU: 18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+6+18	30
			6+6+24	36
			6+9+18	33
			6+9+24	39
			6+12+18	36
			6+12+24	42
			9+9+18	36
			9+9+24	42
			9+12+18	39
			9+12+24	45
			12+12+18	42
			12+12+24	48
			6+6+6+18	36
			6+6+6+24	42
			6+6+9+18	39
			6+6+9+24	45
			6+6+12+18	42
			6+6+12+24	48
			6+9+9+18	42
			6+9+9+24	48
			6+9+12+18	45
			6+9+12+24	51
			6+6+6+6+18	42
			6+6+6+6+24	48
			6+6+6+12+18	48
			6+6+6+12+24	54
			6+9+9+9+18	51
			6+9+9+9+24	57
			6+9+9+12+18	54
			6+9+9+12+24	60
6+9+12+12+18	57			
6+9+12+12+24	63			
6+12+12+12+18	60			
9+9+9+9+18	54			
9+9+9+9+24	60			
9+9+9+12+24	63			
9+9+9+12+18	57			
9+9+12+12+18	60			
9+12+12+12+18	63			

NOTE: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.

MINI-SPLIT COMBINATIONS

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE					Hyper Heat MULTI INDOOR UNITS COMBINATION RULE					
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)		Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)		
			Indoor Units	Total BTHU				Indoor Units	Total BTHU	
A-VMH36QV-1/ A-VMH36QV-1A Hyper 1 drive 4	Wall mounted: 6K/ 9K/12K/24K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18K/24K Console: 12K/18K	Wall mounted: 9+9+9+9 Duct: 9+9+9+9	6+18	24	A-VMH36QV-1/ A-VMH36QV-1A Hyper 1 drive 4	Wall mounted: 6K/ 9K/12K/24K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18K/24K Console: 12K/18K	Wall mounted: 9+9+9+9 Duct: 9+9+9+9	6+9+12+12	39	
			6+24	30				6+9+12+18	45	
			9+18	27				6+9+12+24	51	
			9+24	33				6+9+18+18	51	
			12+12	24				6+9+18+24	57	
			12+18	30				6+9+24+24	63	
			12+24	36				6+12+12+12	42	
			18+18	36				6+12+12+18	48	
			18+24	42				6+12+12+24	54	
			24+24	48				6+12+18+18	54	
			6+6+24	36				6+12+18+24	60	
			6+9+12	27				6+18+18+18	60	
			6+9+18	33				9+9+9+9	36	
			6+9+24	39				9+9+9+12	39	
			6+12+18	36				9+9+9+18	45	
			6+12+24	42				Duct: 9+9+9+9	9+9+9+24	51
			6+18+18	42				9+9+12+12	42	
			6+18+24	48				9+9+12+18	48	
			6+24+24	54				9+9+12+24	54	
			9+9+9	27				9+9+18+18	54	
			9+9+12	30				9+9+18+24	60	
			9+9+18	36				9+12+12+12	45	
			9+9+24	42				9+12+12+18	51	
			9+12+12	54				9+12+12+24	57	
			9+12+18	39				9+12+18+18	57	
			9+12+24	45				9+18+18+18	63	
			9+18+18	45				12+12+12+12	48	
			9+18+24	51				12+12+12+18	54	
			9+24+24	57				12+12+12+24	60	
			12+12+12	36				12+12+18+18	60	
			12+12+18	42				9+18	27	
			12+12+24	48				9+24	33	
			12+18+18	48				12+12	27	
			12+18+24	54				12+18	30	
			12+24+24	60				12+24	26	
			18+18+18	54				18+18	36	
			18+18+24	60				18+24	42	
			6+6+6+18	36				24+24	48	
			6+6+6+24	42				6+18	24	
			6+6+9+12	33				6+24	30	
			6+6+9+18	48				Duct: 9+9+9+9+12	6+36	42
			6+6+9+24	45				9+36	45	
6+6+12+12	36	12+36	48							
6+6+12+18	42	18+36	54							
6+6+12+24	48	24+36	60							
6+6+18+18	48	6+30	36							
6+6+18+24	54	9+30	39							
6+9+9+9	33	12+30	42							
6+9+9+12	36	18+30	48							
6+9+9+18	48	24+30	54							
6+9+9+24	48									

Note: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.
Rules: Outdoor unit Capacity*0.66 <= Indoor unit total capacity <= Outdoor unit Capacity *1.5

MINI-SPLIT COMBINATIONS

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE					Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)		Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU				Indoor Units	Total BTHU
A-VMH48PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18K/24K Console: 12K/18K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	30+30	60	A-VMH48PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18K/24K Console: 12K/18K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+6+12+24	48
			6+6+24	36				6+6+18+18	48
			6+9+12	27				6+6+18+24	54
			6+9+18	60				6+9+9+9	33
			6+9+24	39				6+9+9+12	36
			6+12+18	36				6+9+9+18	42
			6+12+24	42				6+9+9+24	48
			6+18+18	42				6+9+12+12	39
			6+18+24	42				6+9+12+18	45
			6+24+24	54				6+9+12+24	51
			9+9+9	27				6+9+18+18	51
			9+9+12	36				6+9+18+24	57
			9+9+18	36				6+9+24+24	63
			9+9+24	42				6+12+12+12	42
			9+12+12	33				6+12+12+18	48
			9+12+18	39				6+12+12+24	54
			9+12+24	45				6+12+18+18	54
			9+18+18	45				6+12+18+24	60
			9+18+24	51				6+18+18+18	60
			9+24+24	57				9+9+9+9	36
			12+12+12	36				9+9+9+12	34
			12+12+18	42				9+9+9+18	54
			12+12+24	48				9+9+9+24	51
			12+18+18	48				9+9+12+12	42
			12+18+24	54				9+9+12+18	48
			12+24+24	60				9+9+12+24	54
			18+18+18	54				9+9+18+18	54
			18+18+24	60				9+9+18+24	60
			6+6+30	42				9+12+12+12	45
			6+6+36	48				9+12+12+18	51
			6+12+30	48				9+12+12+24	57
			6+12+36	54				9+12+18+18	57
			6+18+30	54				9+18+18+18	63
			6+18+36	60				12+12+12+12	48
			9+9+30	48				12+12+12+18	54
			9+9+36	54				12+12+12+24	60
			9+12+30	51				12+12+18+18	60
			9+12+36	57				6+6+6+30	48
			9+18+30	57				6+6+9+30	51
			9+18+36	63				6+6+12+30	54
			12+12+30	60				9+9+9+30	57
			12+12+36	60				9+9+9+30	57
12+18+30	60	9+9+12+30	60						
6+6+6+18	36	6+6+6+36	54						
6+6+6+24	42	6+6+9+36	57						
6+6+9+12	33	6+6+12+36	60						
6+6+9+18	39	6+9+9+36	60						
6+6+9+24	45	9+9+9+36	63						
6+6+12+12	36	6+6+6+6+6	30						
6+6+12+18	42								

Note: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.
Rules: Outdoor unit Capacity*0.66 <= Indoor unit total capacity <= Outdoor unit Capacity *1.5

MINI-SPLIT COMBINATIONS

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE					Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)		Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU				Indoor Units	Total BTHU
A-VMH48PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K Duct: 9K/12K/18K/24K Console: 12K/18K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+6+6+6+9	33	A-VMH55PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K/24K Duct: 6K/9K/12K/18K/24K Console: 6K/9K/12K/18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	18+36	54
			6+6+6+6+12	36				24+24	48
			6+6+6+6+18	42				24+30	54
			6+6+6+6+24	48				24+36	60
			6+6+6+9+12	39				30+30	60
			6+6+6+12+12	42				6+6+18	30
			6+6+6+12+18	48				6+6+24	36
			6+6+6+12+24	54				6+6+30	42
			6+6+6+18+18	54				6+6+36	48
			6+6+6+18+24	60				6+9+9	24
			6+9+9+9+9	42				6+9+12	27
			6+9+9+9+12	45				6+9+18	33
			6+9+9+9+18	51				6+9+24	39
			6+9+9+9+24	57				6+9+30	45
			6+9+9+12+12	48				6+9+36	51
			6+9+9+12+18	54				6+12+12	30
			6+9+9+12+24	60				6+12+18	36
			6+9+9+18+18	60				6+12+24	42
			6+9+12+12+12	57				6+12+30	48
			6+9+12+12+18	57				6+12+36	54
			6+9+12+12+24	63				6+18+18	42
			6+9+12+18+18	63				6+18+24	48
			6+12+12+12+12	54				6+18+30	54
			6+12+12+12+18	60				6+18+36	60
			9+9+9+9+9	45				6+24+24	54
			9+9+9+9+12	48				9+9+9	27
			9+9+9+9+18	54				9+9+12	30
			9+9+9+9+24	60				9+9+18	36
			9+9+9+12+12	51				9+9+24	42
			9+9+9+12+18	57				9+9+30	48
			9+9+9+18+18	63				9+9+36	54
			9+9+12+12+12	54				9+12+12	33
			9+9+12+12+18	60				9+12+18	39
9+12+12+12+12	57	9+12+24	45						
9+12+12+12+18	63	9+12+30	51						
12+12+12+12+12	60	9+12+36	57						
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K/24K Duct: 6K/9K/12K/18K/24K Console: 6K/9K/12K/18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+24	30	12+12+12	36			
			6+30	36	12+12+18	42			
			6+36	42	12+12+24	48			
			9+18	27	12+12+30	54			
			9+24	33	12+12+36	60			
			9+30	39	12+18+18	48			
			9+36	45	12+18+24	54			
			12+12	24	12+18+30	60			
			12+18	30	12+18+36	66			
			12+24	36	12+24+24	60			
			12+30	32	18+18+18	54			
			12+36	48	18+18+24	60			
			18+18	36	6+6+6+9	27			
			18+24	42	6+6+6+12	30			
			18+30	48	6+6+6+18	34			

Note: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.
Rules: Outdoor unit Capacity*0.66 <= Indoor unit total capacity <= Outdoor unit Capacity *1.5

MINI-SPLIT COMBINATIONS

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K/24K Duct: 6K/9K/12K/18K/24K Console: 6K/9K/12K/18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+6+6+24	42
			6+6+6+30	48
			6+6+6+36	54
			6+6+9+9	30
			6+6+9+12	33
			6+6+9+18	39
			6+6+9+24	45
			6+6+9+30	51
			6+6+9+36	57
			6+6+12+12	36
			6+6+12+18	42
			6+6+12+24	48
			6+6+12+30	52
			6+6+12+36	58
			6+6+18+18	48
			6+6+18+24	52
			6+6+24+24	60
			6+9+9+9	33
			6+9+9+12	36
			6+9+9+18	42
			6+9+9+24	48
			6+9+9+30	54
			6+9+9+36	60
			6+9+12+12	39
			6+9+12+18	45
			6+9+12+24	51
			6+9+12+30	57
			6+9+12+36	63
			6+9+18+18	51
			6+9+18+24	57
			6+12+12+12	42
			6+12+12+18	48
			6+12+12+24	52
			6+12+12+30	58
			6+12+12+36	64
			6+12+18+18	54
			6+12+18+24	60
			6+18+18+18	60
			6+18+18+24	66
			9+9+9+9	36
9+9+9+12	39			
9+9+9+18	45			
9+9+9+24	51			
9+9+9+30	57			
9+9+9+36	63			
9+9+12+12	42			
9+9+12+18	48			
9+9+12+24	54			
9+9+12+30	60			
9+9+12+36	66			
9+9+18+18	54			

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K/24K Duct: 6K/9K/12K/18K/24K Console: 6K/9K/12K/18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	9+9+18+24	60
			9+9+24+24	66
			9+12+12+12	45
			9+12+12+18	51
			9+12+12+24	57
			9+12+12+30	63
			9+12+18+18	57
			9+12+18+24	63
			9+18+18+18	63
			12+12+12+12	48
			12+12+12+18	54
			12+12+12+24	60
			12+12+12+30	66
			12+12+12+36	72
			6+6+6+6+6	30
			6+6+6+6+9	33
			6+6+6+6+12	36
			6+6+6+6+18	42
			6+6+6+6+24	48
			6+6+6+6+30	54
			6+6+6+6+36	60
			6+6+6+9+9	36
			6+6+6+9+12	39
			6+6+6+9+18	45
			6+6+6+9+24	51
			6+6+6+9+30	57
			6+6+6+9+36	63
			6+6+6+12+12	42
			6+6+6+12+24	48
			6+6+6+12+30	54
			6+6+6+12+36	60
			6+6+6+18+18	54
			6+6+9+9+9	39
			6+6+9+9+12	42
			6+6+9+9+18	48
			6+6+9+9+24	54
			6+6+9+9+36	66
			6+6+9+12+12	45
			6+6+9+12+18	51
			6+6+9+12+24	57
6+6+9+12+30	63			
6+6+9+12+36	69			
6+6+9+18+18	57			
6+6+12+12+12	48			
6+6+12+12+18	54			
6+6+12+12+24	60			
6+6+12+12+30	66			
6+6+12+12+36	72			
6+9+9+9+9	42			
6+9+9+9+12	45			
6+9+9+9+18	51			

Note: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.
Rules: Outdoor unit Capacity*0.66 <= Indoor unit total capacity <= Outdoor unit Capacity *1.5



MINI-SPLIT COMBINATIONS

Hyper Heat MULTI INDOOR UNITS COMBINATION RULE				
Multi DC Outdoor Unit	Available Indoor	Standard Combination	Optional Combination(Only Run)	
			Indoor Units	Total BTHU
A-VMH55PV-1 1 drive 5	Wall mounted: 6K/ 9K/12K/24K/30K/36K Cassette: 6K/9K/12K/18K/24K Duct: 6K/9K/12K/18K/24K Console: 6K/9K/12K/18K/24K	Wall mounted: 9+9+9+9+12 Duct: 9+9+9+9+12	6+9+9+9+24	57
			6+9+9+9+30	63
			6+9+9+9+36	69
			6+9+9+12+12	48
			6+9+9+12+18	54
			6+9+9+12+24	60
			6+9+9+12+30	66
			6+9+9+12+36	72
			6+9+9+18+18	60
			6+9+12+12+12	51
			6+9+12+12+18	57
			6+9+12+12+24	63
			6+9+12+12+30	69
			6+9+12+18+18	63
			6+12+12+12+12	54
			6+12+12+12+18	60
			6+12+12+12+24	66
			6+12+12+12+30	72
			9+9+9+9+9	45
			9+9+9+9+12	48
			9+9+9+9+18	54
			9+9+9+9+24	60
			9+9+9+9+30	66
			9+9+9+9+36	72
			9+9+9+12+12	51
			9+9+9+12+18	57
			9+9+9+12+24	63
			9+9+9+12+30	69
			9+9+12+12+12	54
			9+9+12+12+18	60
			9+9+12+12+24	66
			9+9+12+12+30	72
			9+9+18+18+18	72
			9+12+12+12+12	57
			9+12+12+12+18	63
			9+12+12+12+24	69
9+12+12+18+18	69			
12+12+12+12+12	60			
12+12+12+12+18	66			
12+12+12+12+24	72			
12+12+12+18+18	72			

"This product complies with all California product labeling laws including, but not limited to, the Safe Drinking Water and Toxic Enforcement Act of 1986, more commonly known as Proposition 65."

Note: If total indoor units load exceeds nominal capacity of outdoor unit, the practical output capacity of every indoor unit will be correspondingly attenuated. This situation is very evidently during heating mode.

Rules: Outdoor unit Capacity*0.66 <= Indoor unit total capacity <= Outdoor unit Capacity *1.5

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer.

Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Third party incentive and rebate programs have precise requirements as to product performance and certification.

All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product. Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.